


# GMC 500 - 1500 PDI-IAPMO FOR UPC/IAPMO INSTALLATIONS GMC 750, 1000, 1250 FL FOR FLORIDA INSTALLATIONS INSTALLATION PROCEDURE

## NOTES:

1. REFER TO INSTALLATION PROCEDURE AND INSTALLATION CHECKLIST. PROCEPTOR SEPARATORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, PROVINCIAL/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE.
2. US PATENT # 5,746,912; CDN PATENT # 2,195,822
3. NOTE 4: USE FLOW CONTROL AT INLET. USE ADAPTORS WHERE REQUIRED.

NOTE 4: USE FLOW CONTROL AT INLET.  
USE ADAPTORS WHERE REQUIRED.

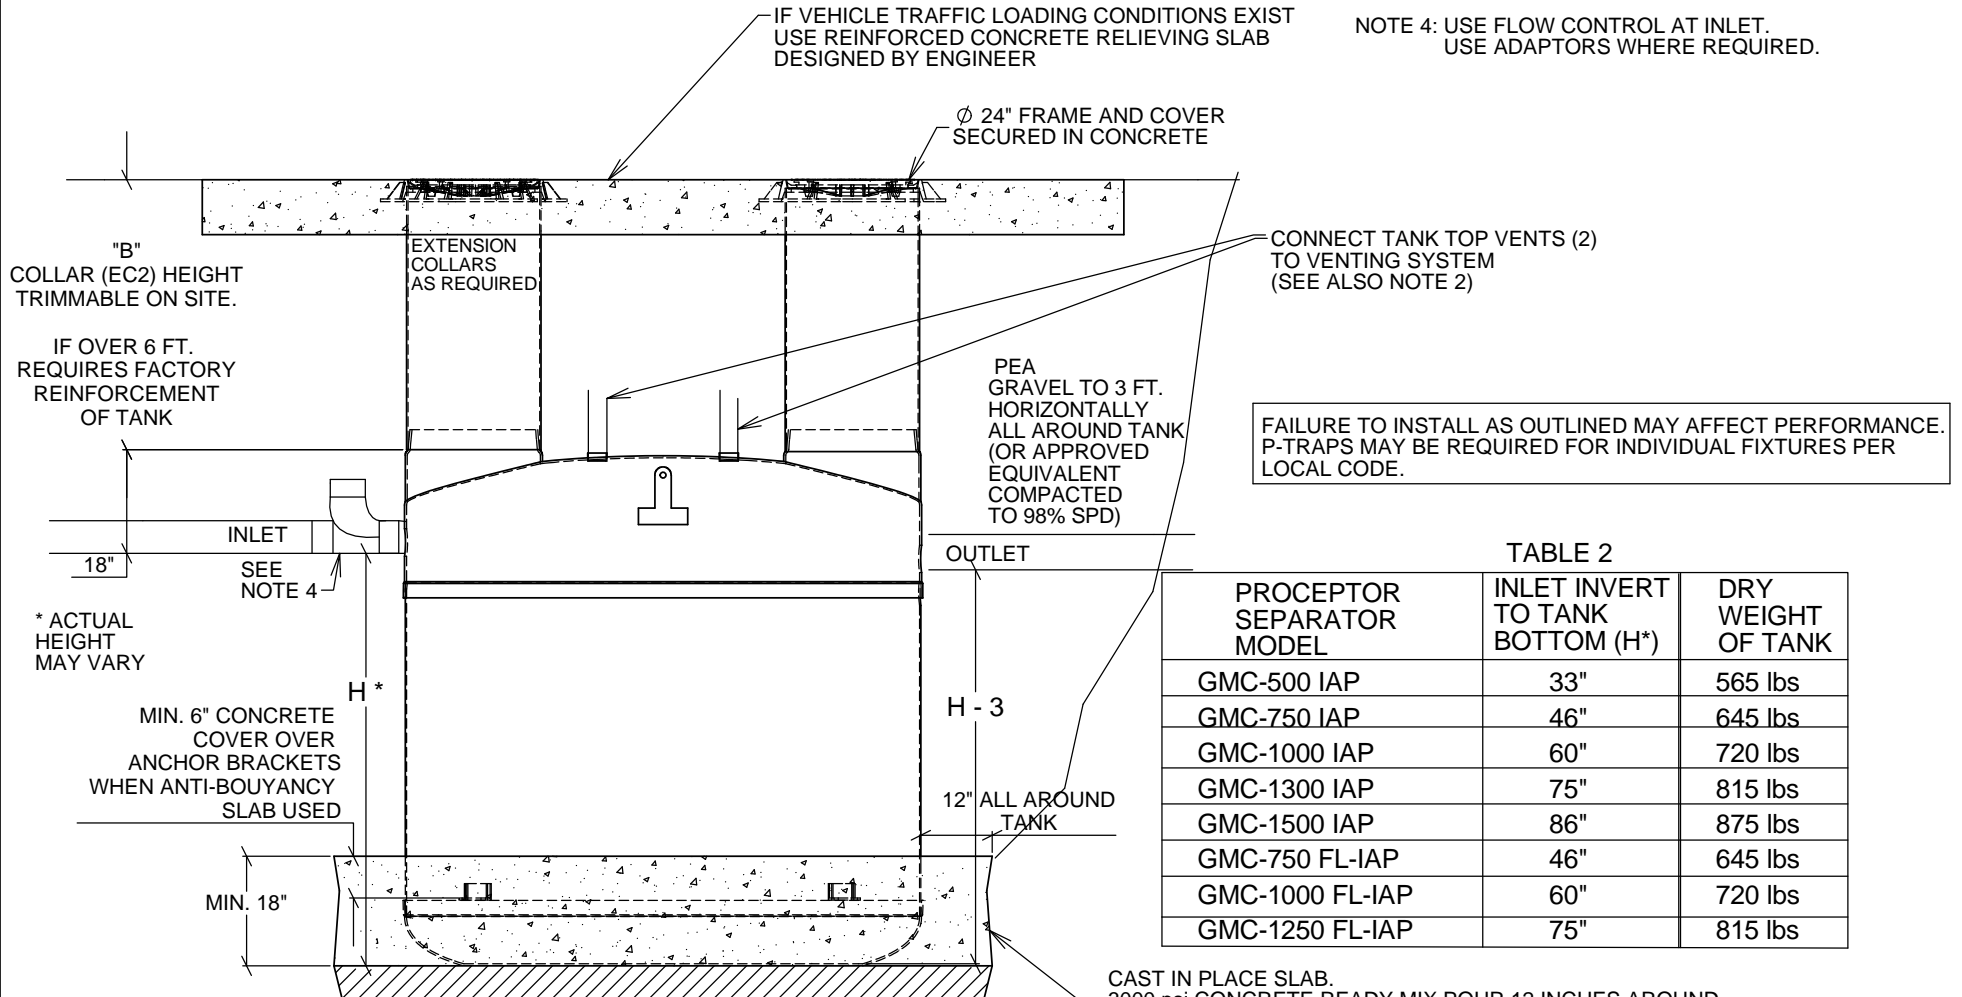

FAILURE TO INSTALL AS OUTLINED MAY AFFECT PERFORMANCE. P-TRAPS MAY BE REQUIRED FOR INDIVIDUAL FIXTURES PER LOCAL CODE.

TABLE 2

PROCEPTOR SEPARATOR MODEL	INLET INVERT TO TANK BOTTOM (H*)	DRY WEIGHT OF TANK
GMC-500 IAP	33"	565 lbs
GMC-750 IAP	46"	645 lbs
GMC-1000 IAP	60"	720 lbs
GMC-1300 IAP	75"	815 lbs
GMC-1500 IAP	86"	875 lbs
GMC-750 FL-IAP	46"	645 lbs
GMC-1000 FL-IAP	60"	720 lbs
GMC-1250 FL-IAP	75"	815 lbs

TABLE 1

BURIAL DEPTH	B
Max.	6 ft.
Min. with Traffic	18"
Min. no Traffic	** 12"

\*\* ESTIMATED SPACE REQUIRED TO FIT VENT ELBOWS UNDER FLOOR

MIN. 6" PEA GRAVEL (OR APPROVED BACKFILL COMPACTED TO 98% SPD)

TITLE: PROCEPTOR F.O.G. SEPARATOR INSTALLATION FOR GMC PDI-IAPMO 500, 750, 1000, 1300, 1500 UPC 750, 1000, 1250 FL

PROJECT: WO:

AVAILABLE OPTIONS (CHECKED IF REQUESTED)

REV	DATE	DRAWN
1	DEC. 23, 2014	S.M.
2	JAN. 20, 2015	S.M.
3	OCT. 22, 2015	S.M.
4	MAY 16, 2017	

DRAWN BY: S. MANGAT  
DRAWN DATE: JUNE 27, 2013



SIZE	DWG. NO.	REV.
A	INSTALL GMC 500-1500(1) PDI-IAPMO	4