


PROCEPTOR GMC, OMC, SMC, 1000(2)-3000(2) DUAL TANK ABOVE GROUND INSTALLATION

PROCEPTOR SEPARATOR MODEL	INLET INVERT TO TANK BOTTOM (H)	WEIGHT OF BOTH TANK FULL OF WATER	WEIGHT OF BOTH EMPTY TANK
MC 500	32"	9435	1000
MC 750-LEA*	45"	13765	1150
MC 1000-LEA*	59"	18095	1300
MC 1300-LEA*	74"	23290	1490
MC 1500-LEA*	85"	26755	1610

* WITH STABILIZERS TO PREVENT TIPPING

NOTES:

1. ENSURE FLOOR IS LEVEL, SMOOTH AND IS ABLE TO SUPPORT THE WEIGHT OF THE TANKS FULL OF WATER AT THE INSTALLATION LOCATION. TANK BOTTOM IS TO BE FULLY SUPPORTED.
2. MOVE TANKS INTO POSITION. CHECK FIT AND LOCATION OF INLET, OULET AND VENT PIPING.
3. IF APPLICABLE, CONNECT OUTLET OF UPSTREAM TANK WITH INLET OF DOWNSTREAM TANK
4. ENSURE ACCESSWAY IS ACCESSIBLE FOR COVER REMOVAL AND PUMPOUT AS WELL AS ACCESS TO THE INTERIOR. ENSURE ALL OTHER PORTS ARE ACCESSIBLE FOR INSTALLATION AND MAINTENANCE.
ALARM OR LEVEL PROBE (IF SUPPLIED) SHOULD HAVE SUFFICIENT HEADSPACE FOR REMOVAL FOR SERVICE.
5. ENSURE AREA AROUND TANK IS HEATED TO PREVENT FREEZING OF WATER IN TANKS AND PIPES.
6. THE STABILIZATION BRACKETS (IF EQUIPPED) MAY BE AFFIXED TO FLOOR IF DESIRED.
7. SEISMIC RESTRAINTS TO BE PROVIDED BY OTHERS IF REQUIRED BY LOCAL AUTHORITIES
8. INSTALL INLET, OUTLET AND VENT PIPES TO MEET LOCAL PLUMBING CODE.
9. UNITS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, STATE/PROVINCIAL AND LOCAL CODES

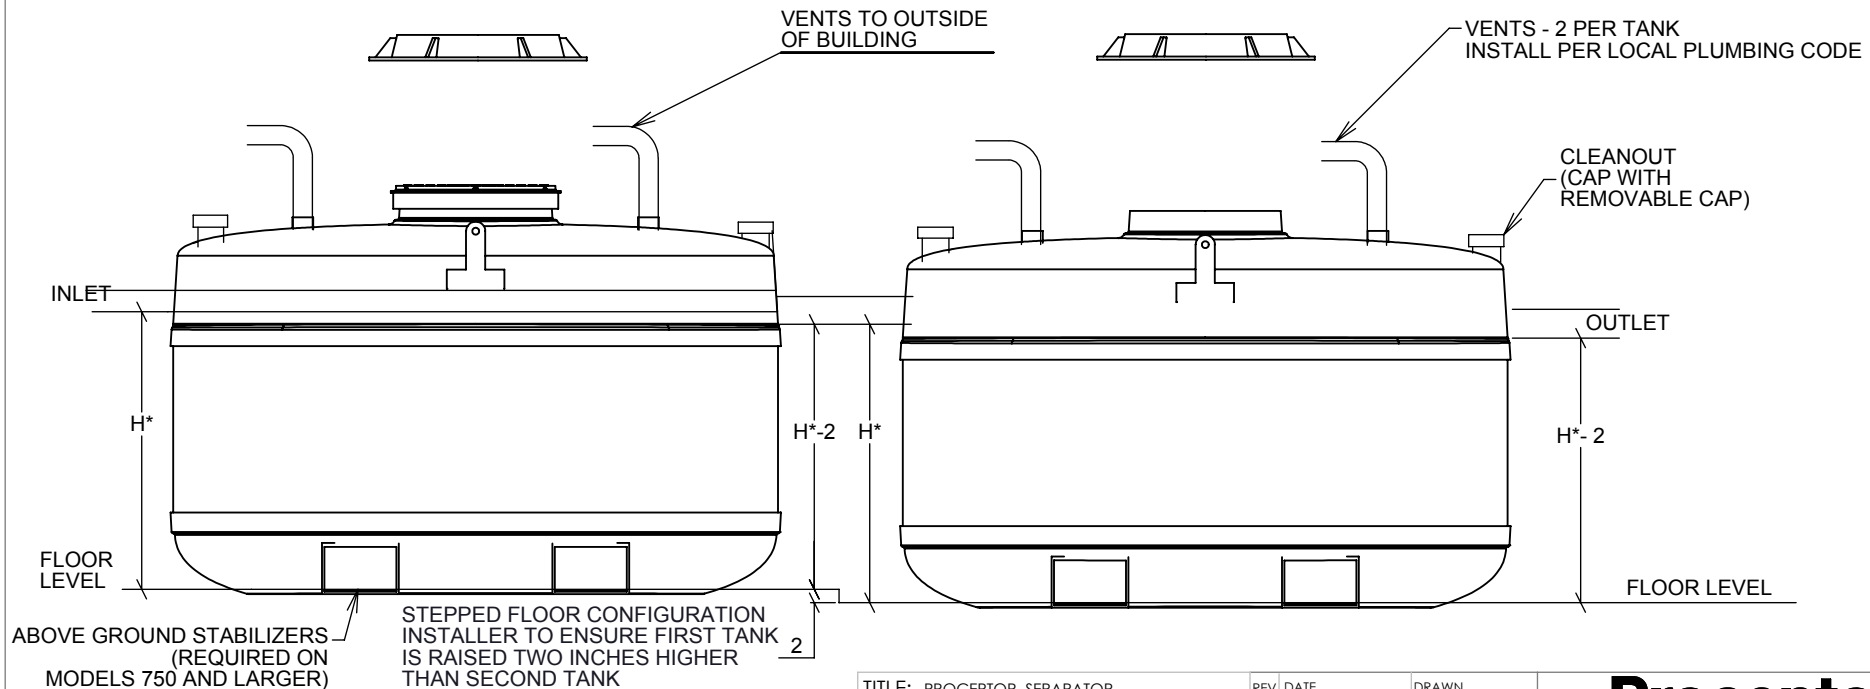

TITLE: PROCEPTOR SEPARATOR
INSTALLATION PROCEDURE
ABOVE GROUND TWO TANK MODELS
ALL DIMENSIONS IN INCHES
PROJECT: WO:

REV	DATE	DRAWN
1	APRIL 18, 2007	L. SIMKINS
2	JANUARY 30, 2008	L. SIMKINS
3	FEBRUARY 5, 2008	L. SIMKINS
4	NOVEMBER 21, 2008	L. SIMKINS
5	AUGUST 14, 2009	L. SIMKINS
6	DEC 21, 2010	L. SIMKINS
7	MAY 09, 2013	S. MANGAT
8	JUNE 10, 2016	
9	MAY 26, 2017	
10		

DRAWN BY: L. SIMKINS

DRAWN DATE: 03/16/06

Proceptor
ZURN

SIZE	DWG. NO.	REV.
A	INSTALL TWO TANK ABOVE GROUND	10

SCALE: NTS DO NOT SCALE DRAWING SHEET 1 OF 1