
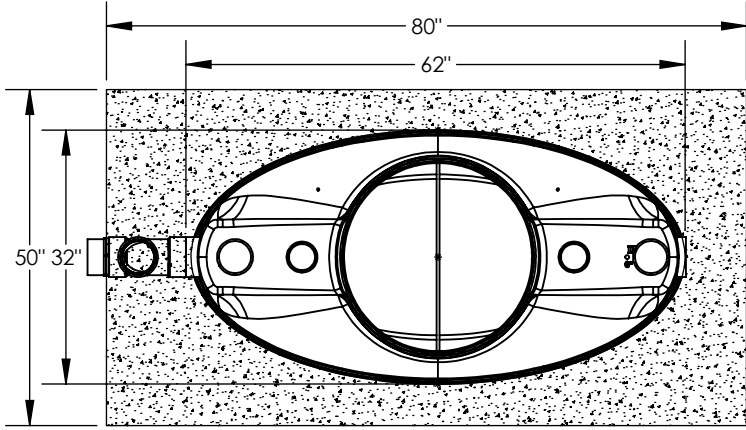


NOTES:

1. REFER TO INSTALLATION PROCEDURE AND INSTALLATION CHECKLIST
2. GEOTEXTILE FABRIC SHOULD BE USED IF THE NATIVE SOIL HAS SMALL PARTICLES AND MORE THAN 3% OF ITS WEIGHT PASSING THROUGH A #8 SLIEVE (2.38mm SQUARE SCREEN OPENING) REGARDLESS OF THE BACKFILL MATERIAL
3. PROCEPTOR SEPARATORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELECAT FEDERAL, PROVINCIAL/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE
4. ZURN GREEN TURTLE RECOMMENDS CAST IN PLACE ANCHORING SLAB TO USE AT LEAST 3000PSI CONCRETE POURED ALL AROUND TANK. APPROXIMATELY 16CU FT NEEDED
5. BACKFILL MATERIAL (PREFERRED TO BE 3/4" PEA GRAVEL, ALTERNATIVE TO BE 3/4" CRUSHED STONE) SHALL BE COMPACTED TO 98% SPD
6. VENTS TO BE CONNECTED TO VENTING SYSTEM, AS PER LOCAL CODES
7. CLEANOUTS TO BE CAPPED IN FIELD, AS PER LOCAL CODES
8. IF THE GROUND WATER TABLE IS MORE THAN ONE FOOT HIGHER THAN THE BOTTOM OF THE TANK, A CUSTOM DESIGN TANK AND PROPER ANTI BUOYANCY SLAB SHOULD BE USED. PLEASE CONTACT GT FOR MORE INFORMATION.

GMC MODEL SIZE (CAPACITY US GAL)	INLET (A)	OUTLET (B)	WEIGHT (LBS)
150	33	32	194

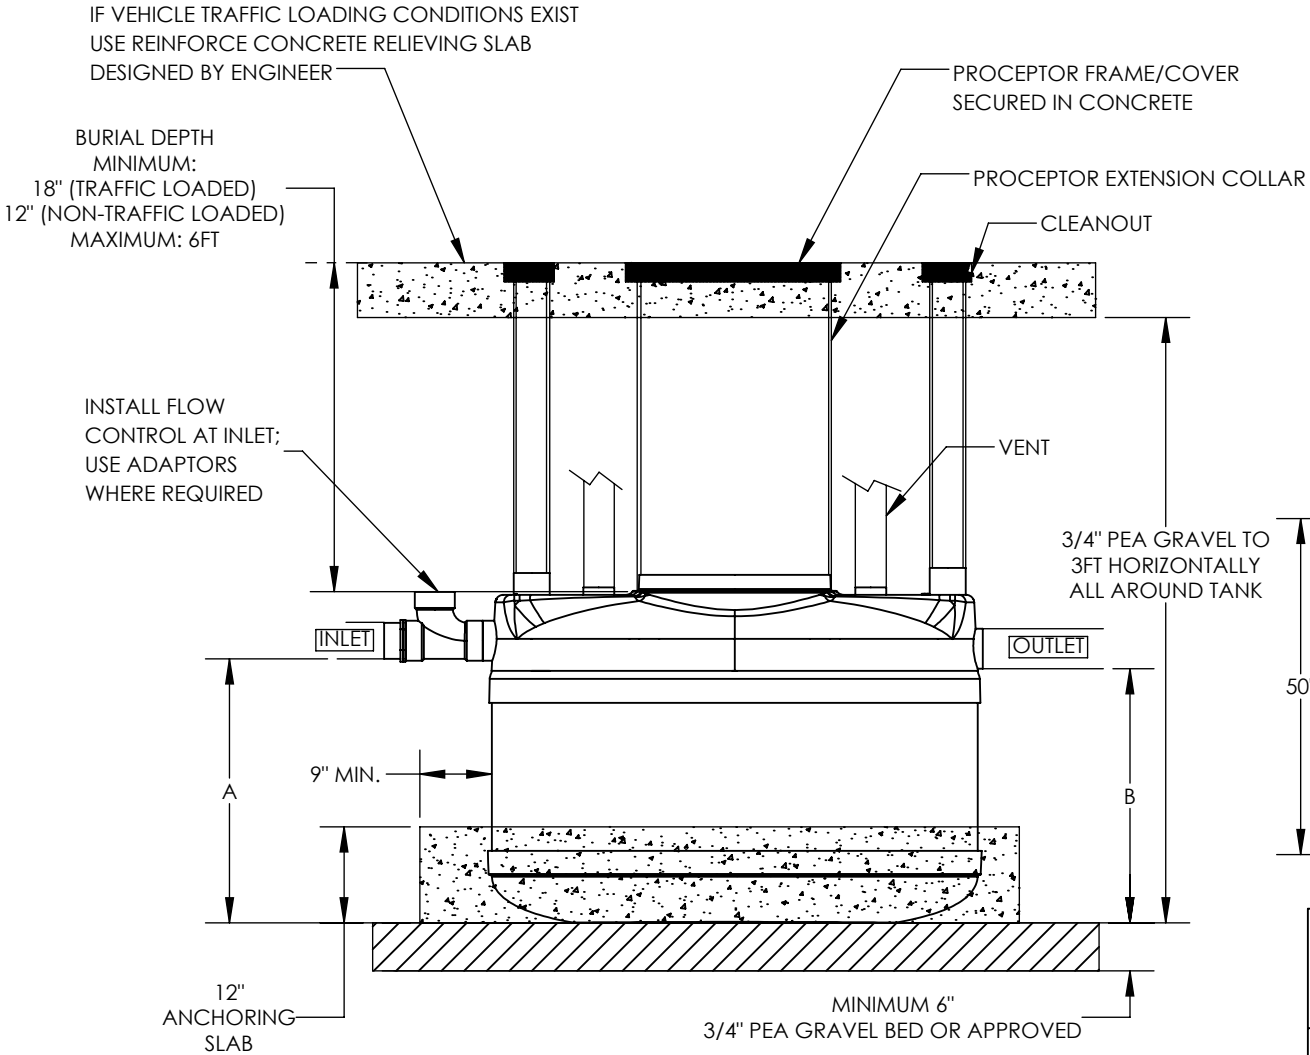

ANCHORING SLAB DIMENSIONS

**MUST BE INSTALLED WITH SUPPLIED FLOW CONTROL DEVICE AS TESTED AND AS SHOWN IN DRAWING**

DWG. TITLE:  
INSTALL GMC 150 S24M  
IAP WITH FLOW  
CONTROL

PROJECT:



SIZE A DRAWING NOT TO SCALE

DWG #: 23-5563-S REV. 1