


# INSTRUCTION SHEET ZW1070 SERIES TMV ROMAN BATH APPLICATIONS

**WILKINS**  
a **ZURN** company

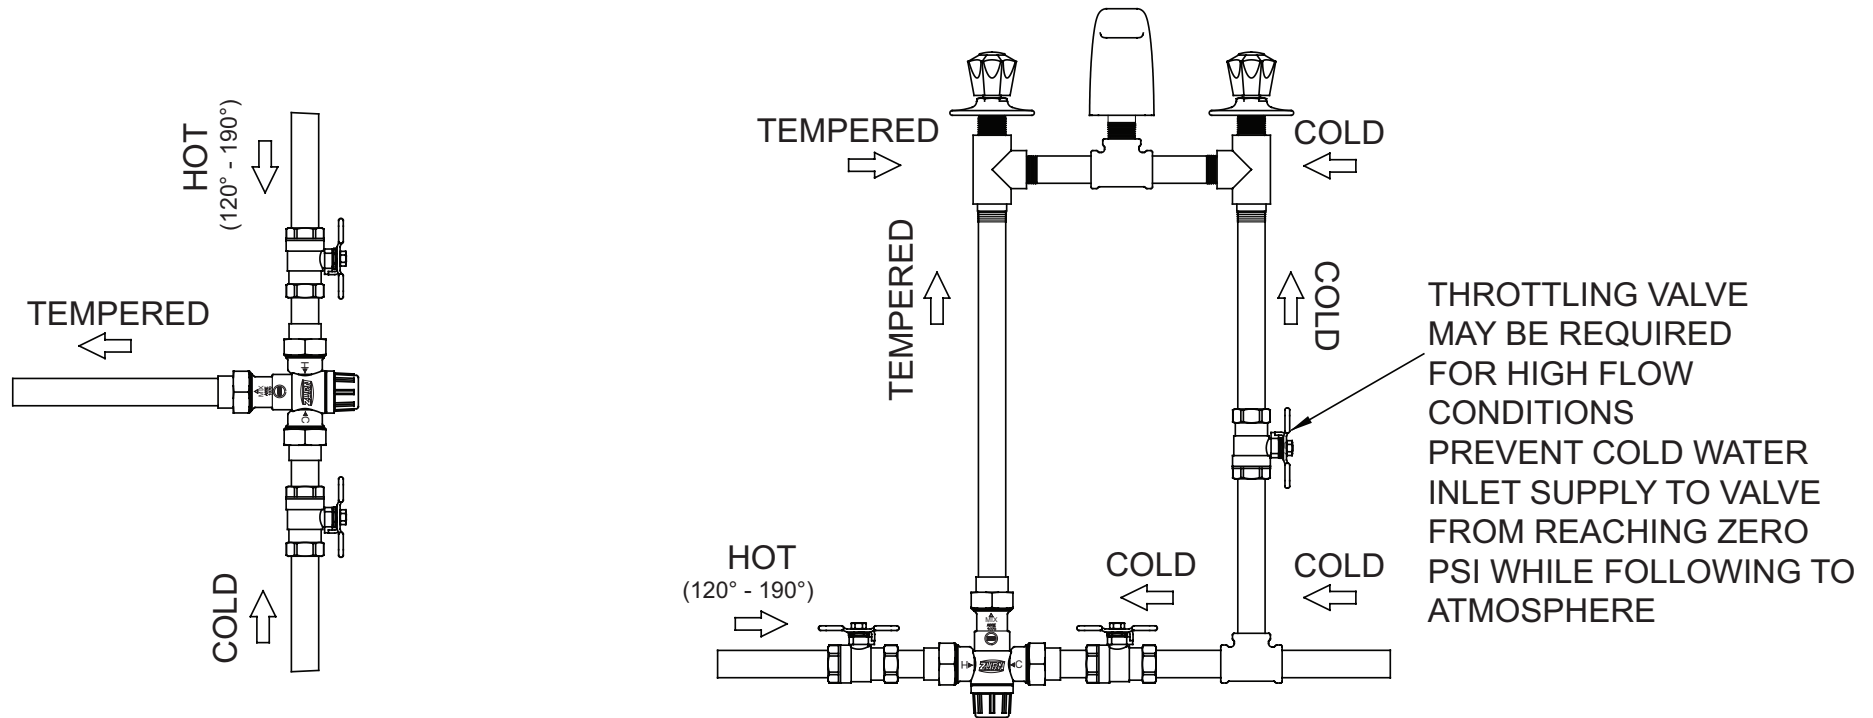

TYPICAL HORIZONTAL FEED  
FOR INSTALLATIONS WHERE TEMPERED OUTLET IS  
HORIZONTAL IT IS RECOMMENDED TO PLUMB THE HOT  
WATER FEED FROM ABOVE THE VALVE TO INSURE  
PROPER THERMOSTATIC OPERATION.

TYPICAL ROMAN BATH INSTALLATION  
FOR INSTALLATIONS WHERE TEMPERED OUTLET IS  
VERTICAL IT IS RECOMMENDED NOT TO EXCEED 190°  
ON THE HOT WATER FEED TEMPERATURE TO INSURE  
PROPER THERMOSTATIC OPERATION.

NOTE: CHECK VALVES MUST BE USED FOR BOTH  
HOT AND COLD FEEDS TO THE DEVICE IN EITHER CONFIGURATION.

**WILKINS**  
a **ZURN** company