




# Z1204-N-XB

BARIATRIC CARRIER - 1000 LB. [454 KG.]  
ADJUSTABLE VERTICAL SIPHON JET NO-HUB

Design and Dimensional Data (inches and [ mm ]) are Subject to Manufacturing Tolerances and Change Without Notice

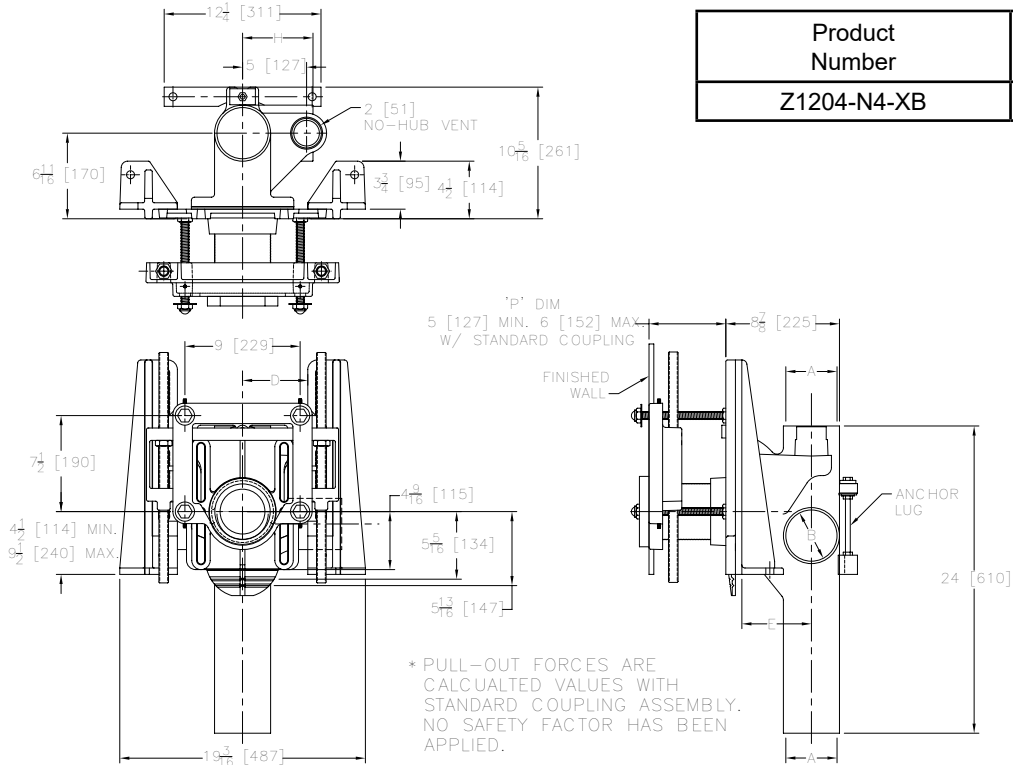

Product Number	Approx. Wt. Lbs. [kg]
Z1204-N4-XB	114 [49]

**ENGINEERING SPECIFICATION:** ZURN Z1204-N4-XB Adjustable, vertical siphon jet water closet “Rigid System” with 4 [102] No-Hub connections and optional side inlets rated for 1000-Lb. [454 kg.] maximum static load. Dura-Coated cast iron main fitting, with 2 [51] vent, adjustable gasketed faceplate, floor mounted foot supports, stud support / finishing frame, corrosion resistant adjustable cast iron coupling, fixture bolts, trim, and stud protectors. Complete with rear anchor tie down and bonded “Neo-Seal” gasket. Carrier complies with all applicable requirements of ASME A112.6.1M up to a 1000-Lb. [454-kg.] load.

**OPTIONS** (Check/specify appropriate options)

\_\_\_ Z1204-N4-XB No-Hub Stack, Single Inlet, 2 [51] Right Hand Vent

**PREFIXES**

\_\_\_ Z D.C.C.I. System with Zurn “ZZ” Adjustable Coupling\*  
\_\_\_ ZQ D.C.C.I. System with NPT Faceplate, Non-Adjustable Coupling

**SUFFIXES**

\_\_\_ -BC Back Cleanout  
\_\_\_ -G Galvanized Cast Iron  
\_\_\_ -JJ Two 2” [51] Auxiliary Inlets  
\_\_\_ -JL 2 [51] Left-Hand Auxiliary Inlet  
\_\_\_ -JR 2 [51] Right-Hand Auxiliary Inlet  
\_\_\_ -VL Left Hand Vent Connection  
\_\_\_ -VP Vandal-Proof Trim  
\_\_\_ -29 Mechanical Test Cap Assembly  
\_\_\_ -45 Finishing Frame for Siphon Jet System  
\_\_\_ -50 Flush Valve Supply Support for W.C.  
\_\_\_ -61 “ZZ” Coupling Wrench

\* Regularly furnished unless otherwise specified

**⚠ WARNING:** Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

**⚠ ADVERTENCIA:** Cáncer y daño reproductivo - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

**⚠ AVERTISSEMENT:** Cancer et effets néfastes sur la reproduction - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

Zurn Industries, LLC | Specification Drainage Operation  
1801 Pittsburgh Avenue, Erie, PA 16502, Ph. 855.663.9876

In Canada | Zurn Industries Limited  
7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, Ph. 877.892.5216

[www.zurn.com](http://www.zurn.com)

**Note:**

1. Feet and rear anchor bolted to floor using anchors capable of achieving the specified pull-out force.
2. Min. ‘P’ Dim. Obtainable=2 [51]
3. Back anchor foot mandatory for secure installation.
4. 2 [51] No-Hub vent connection regularly furnished on right hand side. Left hand available when specified (Suffix- VL)
5. Auxiliary inlet available right (-JR) or left (-JL) or both sides (-JJ) when specified.
6. Floor anchors each must be able to withstand a pull-out force of 745 lbs. [338 kg].

Rev.	C
Date:	12/30/22
C.N. No.	144897
Patent	<a href="http://zurn.com/patents">zurn.com/patents</a>
Prod.   Dwg. No.	Z1204-N-XB