
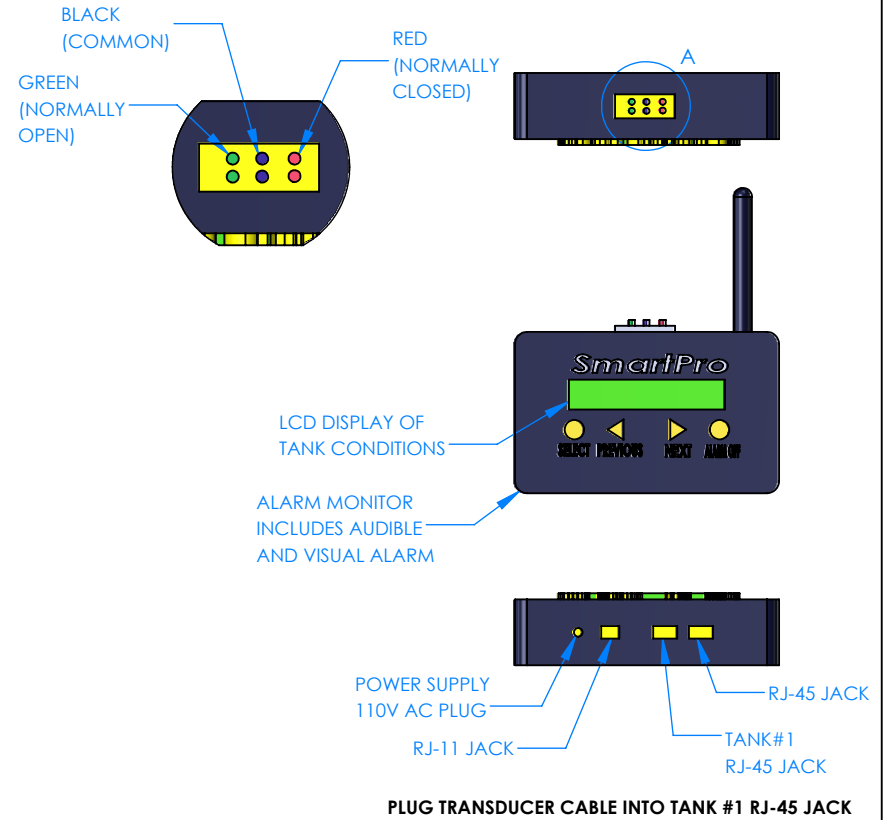


**SEE OWNER'S MANUAL FOR CALIBRATION PROCEDURE**

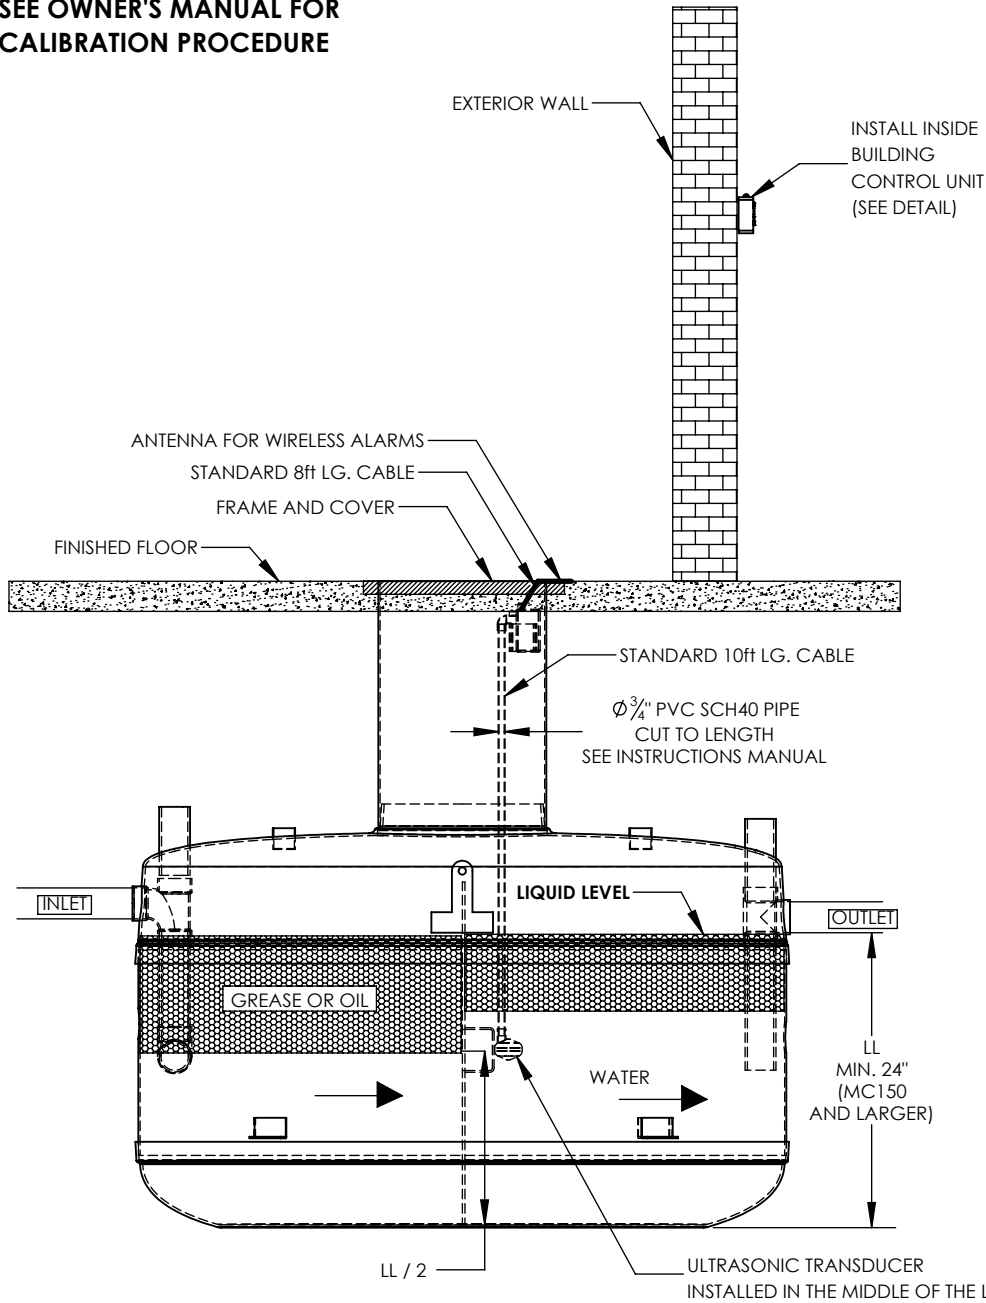

1. TANKS INSTALLED IN SERIES (EX. GMC 2000(2)) WILL HAVE ALARM INSTALLED IN THE FIRST TANK OUTLET SIDE
2. SINGLE TANKS (WITH BAFFLE) WILL HAVE ALARM INSTALLED ON THE INLET SIDE (BOTH INLET AND OUTLET INSTALLATION IS ALLOWED BUT GT RECOMMENDS INLET)

ALARM IS SHOWN TO BE INSTALLED ON OUTLET SIDE OF TANK

**SKU 4630**  
**INTERNAL PART #G4-4641**

DWG. TITLE:  
SMARTPRO WIRELESS  
ALARM G4 OUTLET SIDE  
INSTALLATION

PROJECT:



SIZE A DRAWING NOT TO SCALE

DWG #: **21-5486-S** REV. 1